
NOTES:

- g. RAILROAD BALLAST OR SURGE STONE SHALL BE USED. PAD TO BE 50'L X 20'W X 6" D AT A MINIMUM.
- TURNING RADIUS SUFFICIENT TO ACCOMMODATE LARGE TRUCKS IS TO BE PROVIDED.
- c. ENTRANCE(S) SHOULD BE LOCATED TO PROVIDE FOR MAXIMUM UTILITY BY ALL CONSTRUCTION VEHICLES.
- d. MUST BE MAINTAINED IN A CONDITION
 WHICH WILL PREVENT TRACKING OR
 DIRECT FLOW OF MUD ONTO STREETS.
 PERIODIC TOPDRESSING WITH STONE
 SILL BE NECESSARY; KEEP SOME HANDY.
- e. ANY MATERIAL WHICH STILL MAKES IT ONTO THE ROAD MUST BE CLEANED UP IMMEDIATELY.

NOTES: APPLICABLE AT ALL POINTS OF INGRESS & EGRESS UNTIL SITE IS STABILIZED, FREQUENT CHECKS OF THE DEVICE AND TIMELY MAINTENANCE MUST BE PROVIDED.



NOT TO SCALE

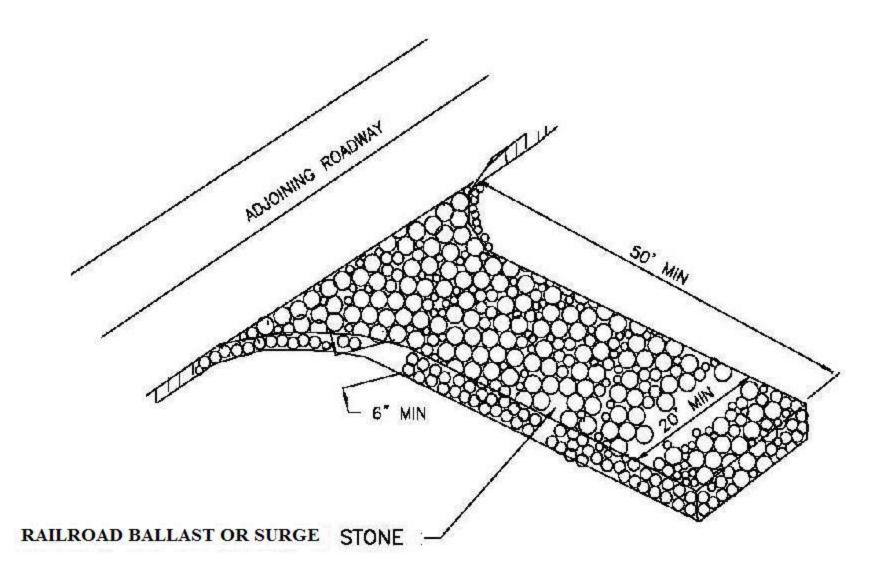

EROSION CONTROL DETAIL
DURHAM COUNTY, NC
ENGINEERING DEPARTMENT

CONSTRUCTION ENTRANCE

	100000
02/09	CE - 1