


NOTES:

- a. RAILROAD BALLAST OR SURGE STONE SHALL BE USED. PAD TO BE 50'L X 20'W X 6" D AT A MINIMUM.
- b. TURNING RADIUS SUFFICIENT TO ACCOMMODATE LARGE TRUCKS IS TO BE PROVIDED.
- c. ENTRANCE(S) SHOULD BE LOCATED TO PROVIDE FOR MAXIMUM UTILITY BY ALL CONSTRUCTION VEHICLES.
- d. MUST BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR DIRECT FLOW OF MUD ONTO STREETS. PERIODIC TOPDRESSING WITH STONE SILL BE NECESSARY; KEEP SOME HANDY.
- e. ANY MATERIAL WHICH STILL MAKES IT ONTO THE ROAD MUST BE CLEANED UP IMMEDIATELY.

NOTES: APPLICABLE AT ALL POINTS OF INGRESS & EGRESS UNTIL SITE IS STABILIZED, FREQUENT CHECKS OF THE DEVICE AND TIMELY MAINTENANCE MUST BE PROVIDED.

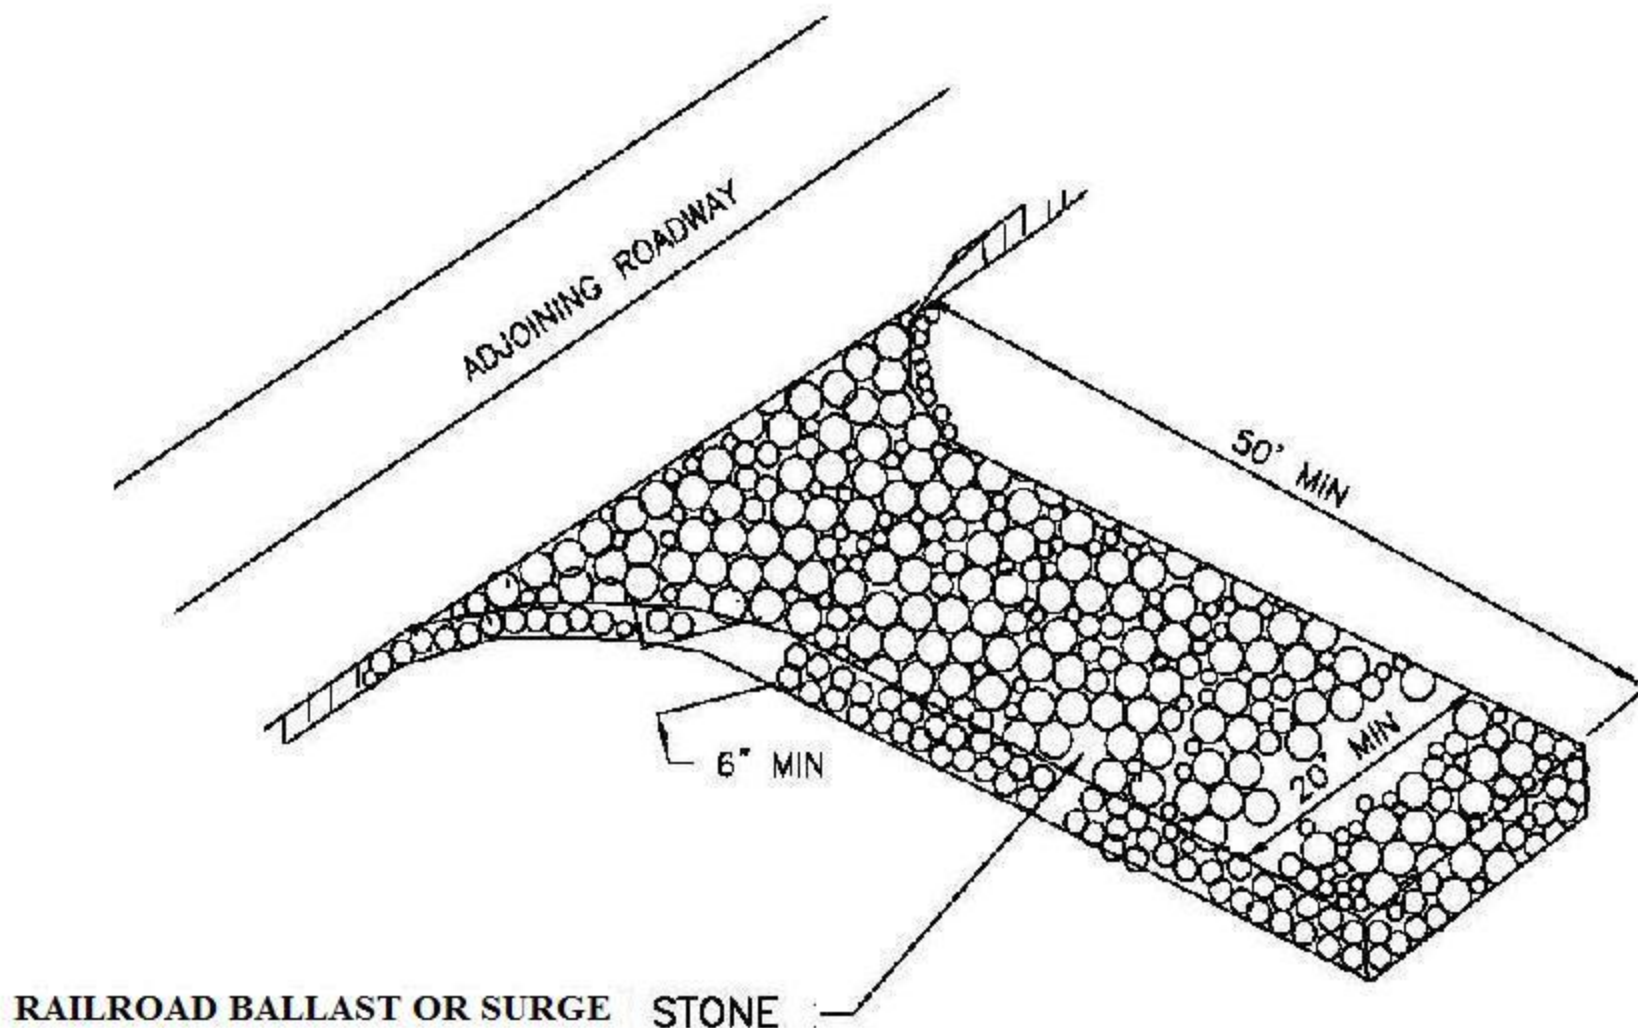

NOT TO SCALE



EROSION CONTROL DETAIL
DURHAM COUNTY, NC
ENGINEERING DEPARTMENT

REV:

CONSTRUCTION ENTRANCE

DATE	ID
02/09	CE - 1